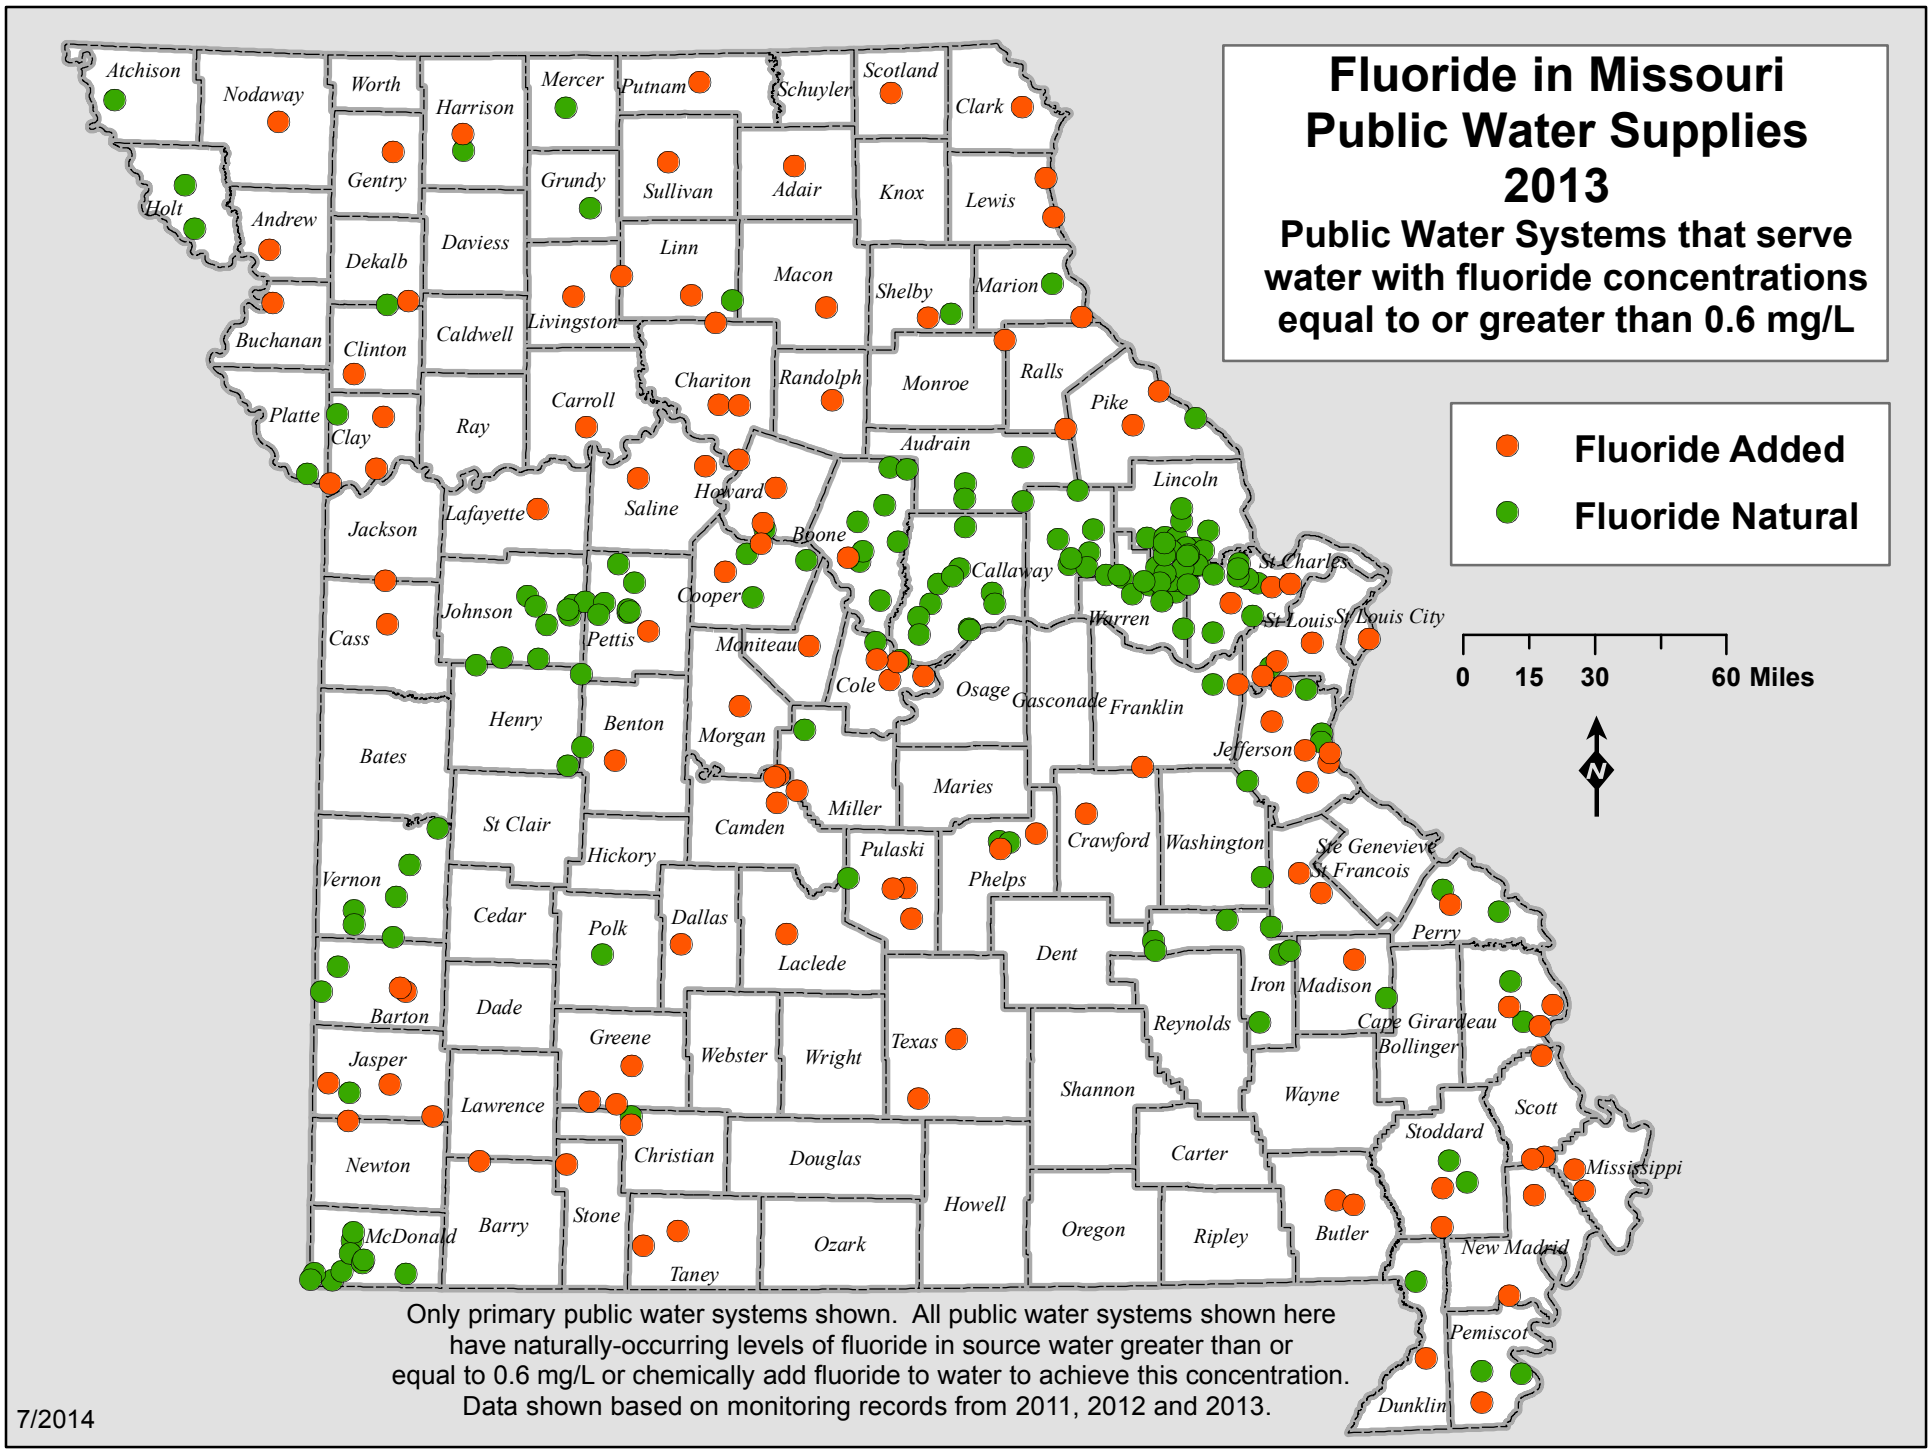

Only primary public water systems shown. All public water systems shown here have naturally-occurring levels of fluoride in source water greater than or equal to 0.6 mg/L or chemically add fluoride to water to achieve this concentration. Data shown based on monitoring records from 2011, 2012 and 2013.

7/2014