


Fluoride in Missouri Public Water Supplies

Public Water Systems that Serve Water with Fluoride Concentrations equal to or greater than 0.6 mg/L

0 20 40 80 Miles



- Natural Fluoride
- Added Fluoride

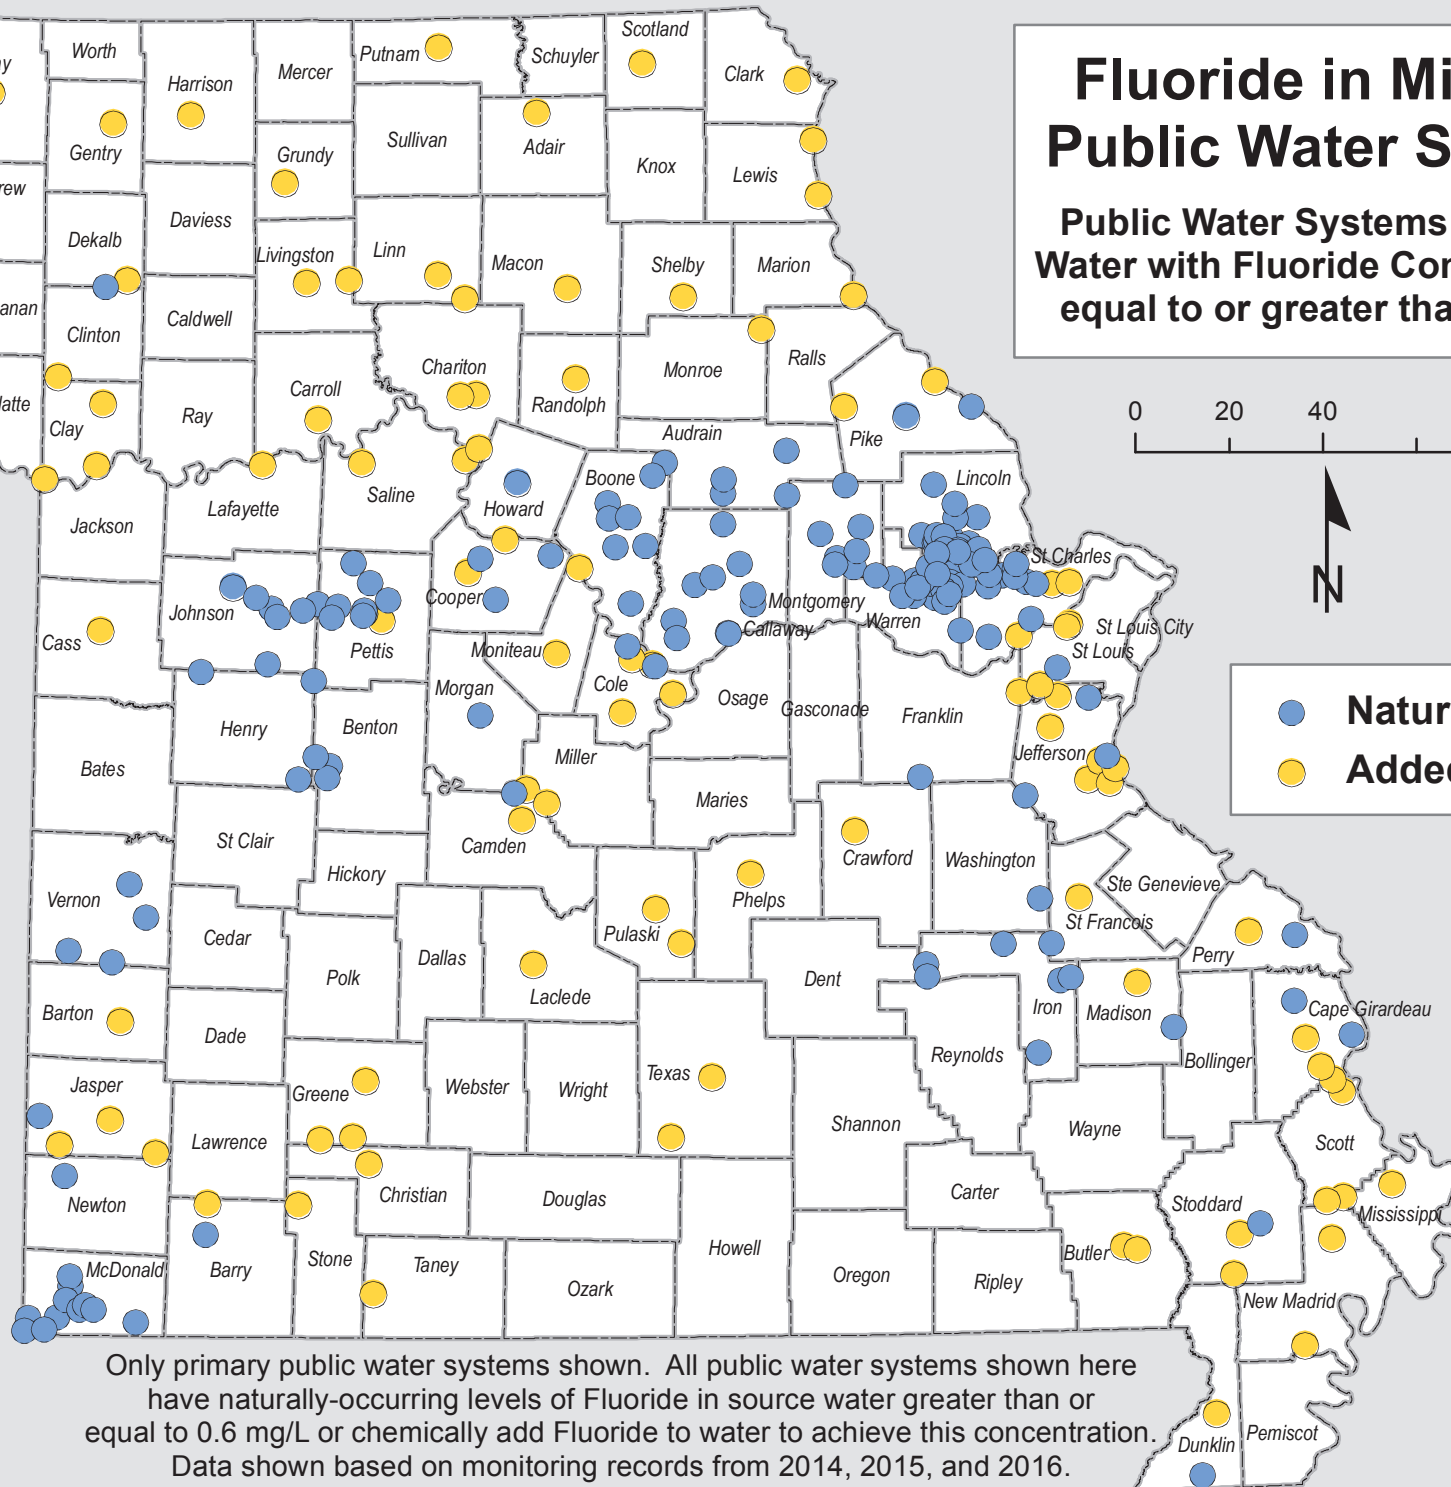

Only primary public water systems shown. All public water systems shown here have naturally-occurring levels of Fluoride in source water greater than or equal to 0.6 mg/L or chemically add Fluoride to water to achieve this concentration. Data shown based on monitoring records from 2014, 2015, and 2016.